


SERVICE LINE SIZE	MINIMUM METER BOX SIZE	BOX MODEL	LID / FRAME MODEL	COMMENTS	INSULATION INSERTS
1" MINIMUM	18" x 60"	330CS1860FSBS000390N	780113 / NA	NEW SERVICES	790153
1 1/2"	24" x 60"	500VS2460FVB000520N	780113 / 700098-1	"	790325
2"	27" x 60"	550VS2760FVB000520N	780113 / 700098-1	"	790327

NOTE 1: FOR LARGER SIZES CONTACT PUBLIC WORKS FOR REQUIREMENTS

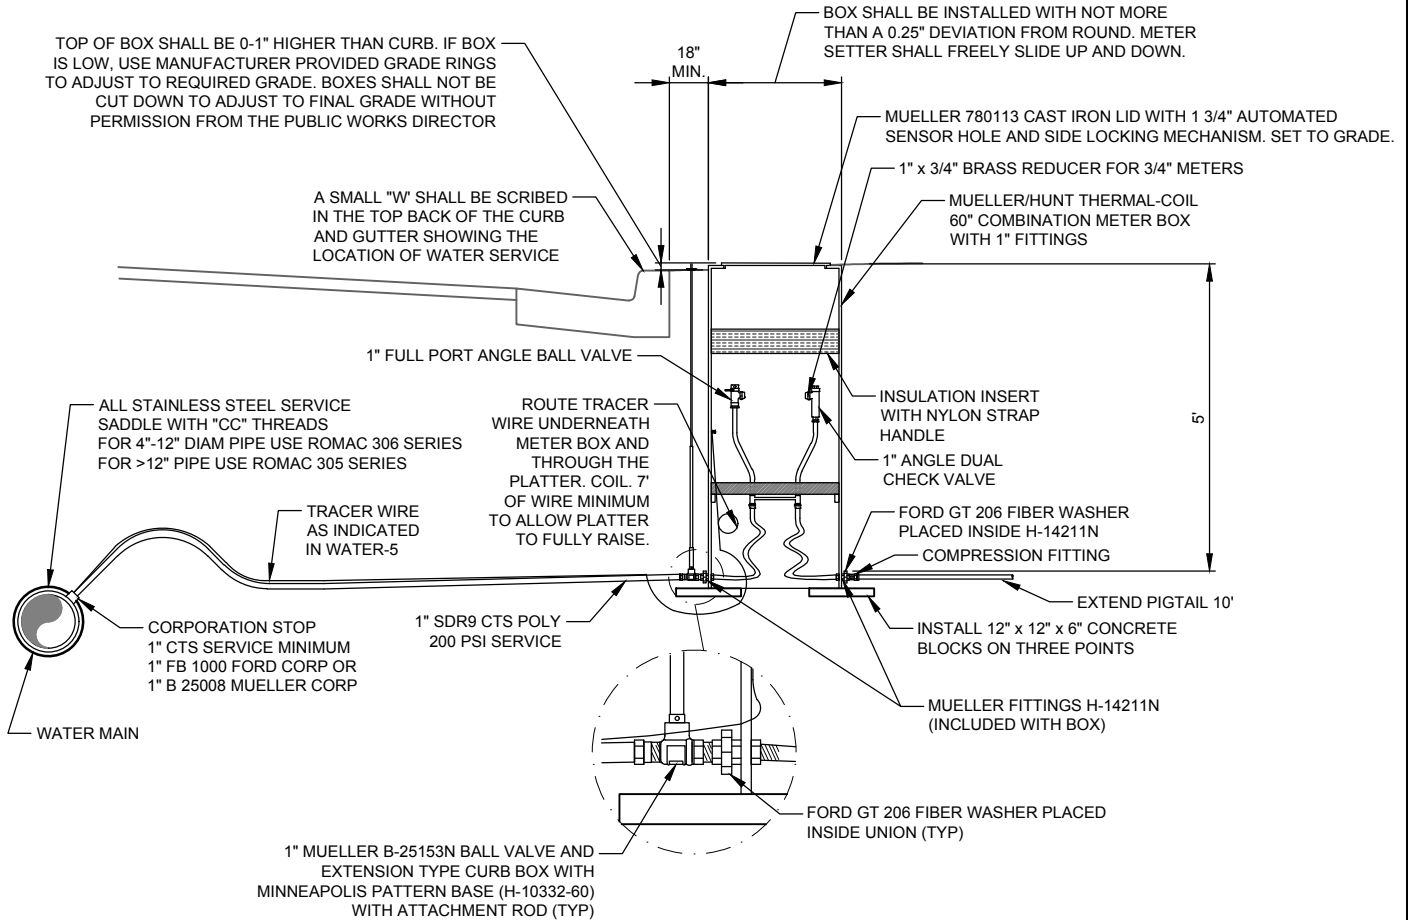

NOTES:

- METER BOX, COVER, COPPER SETTER, CORPORATION STOP, & SERVICE LINES TO BE FURNISHED AND INSTALLED BY DEVELOPER AND CONFORM TO AWWA C800.
- STAINLESS STEEL STIFFENERS ON ALL POLY CONNECTIONS.
- METER BOXES ARE ALLOWED WITHIN DRIVEWAY ZONE ONLY WITH PRIOR APPROVAL FROM PUBLIC WORKS DIRECTOR.
- WATER METER WILL BE INSTALLED BY HEBER CITY.
- SEE UTILS-3 FOR PLAN VIEW.
- WATER METER CAN TO BE LOCATED IN THE MIDDLE OF THE PLANTER STRIP OR BETWEEN SIDEWALK AND PROPERTY LINE (FOR COMBINATION SIDEWALK) OR AS DIRECTED BY ENGINEER.
- WATER SERVICE SHOULD CONNECT DIRECTLY TO THE MAIN LINE AND NOT "TEE" OFF FIRE HYDRANT LINE OR SERVICE LINES.
- WATER METER CAN SHALL BE COMPLETELY BACKFILLED WITH COMPACTED 3" MINUS GRANULAR MATERIAL FROM TOP TO BOTTOM.
- UNDER NO CIRCUMSTANCES SHALL THREAD SEALANT PASTE INCLUDING PIPE JOINT COMPOUND, PIPE DOPE, TEFLON PASTE, ETC. BE USED ON CITY INFRASTRUCTURE.
- METER FEE WILL BE ASSESSED WITH BUILDING PERMIT OR AT TIME OF METER INSTALLATION.

WATER SERVICE - SINGLE LOTS

V:\ENGR\Status\Spec\Sds\Spec 2019\Drawg Files\WATER-6B.dwg - Service 1 Lot - 2/06/2019 12:57pm. rfrnk


HORROCKS
ENGINEERS

728 WEST 100 SOUTH #2
HEBER CITY, UTAH 84032
(435) 654-2226

DATE: FEBRUARY 2019

SCALE: N.T.S.

75 NORTH MAIN STREET
HEBER CITY, UTAH 84032
(435) 654-0757



HEBER CITY
STANDARD DRAWING

WATER-6B